

Notice of Testing and Classification

COMPANY	FRIULSIDER S.p.A.
ADDRESS	VIA TRIESTE, 1 33048 SAN GIOVANNI AL NATISONE (ITALIA)
TEST REPORT No.	13_03139-2-a
TEST DATE	18/03/2013


SAMPLE TESTED

PU foam referenced as «**PUR 967**».

CONDUCTED TEST

Fire Resistance test according to EN 1366-4:2006+A1:2010 "Fire resistance tests for service installations. Part 4: Linear joint seals".
(Classification UNE-EN 13501-3:2007+A1:2010).

CONFIGURATION

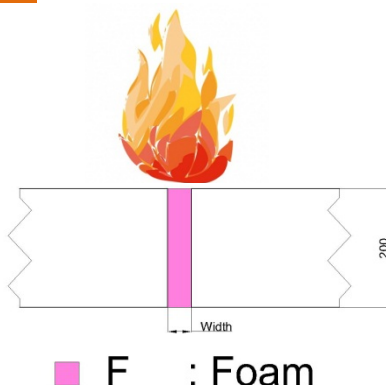

RESULT

CLASSIFICATION:
EI90 V- X - F- W 10 to 40
EI180 V- X - F- W 10 to 30
EI240 V- X - F- W 10 to 20

date 20/09/2013

This document must be accompanied with the classification report 13_03139-2-a.

The results obtained in these tests relate only to the samples analyzed in this Centre at the date indicated and do not involve a feature of consistency in the quality of production.

This document cannot be used in Product Certification Processes.

Signed: Izaskun Martínez
Head of Fire Safety Lab

tecnalia Inspiring Business